


PLAN

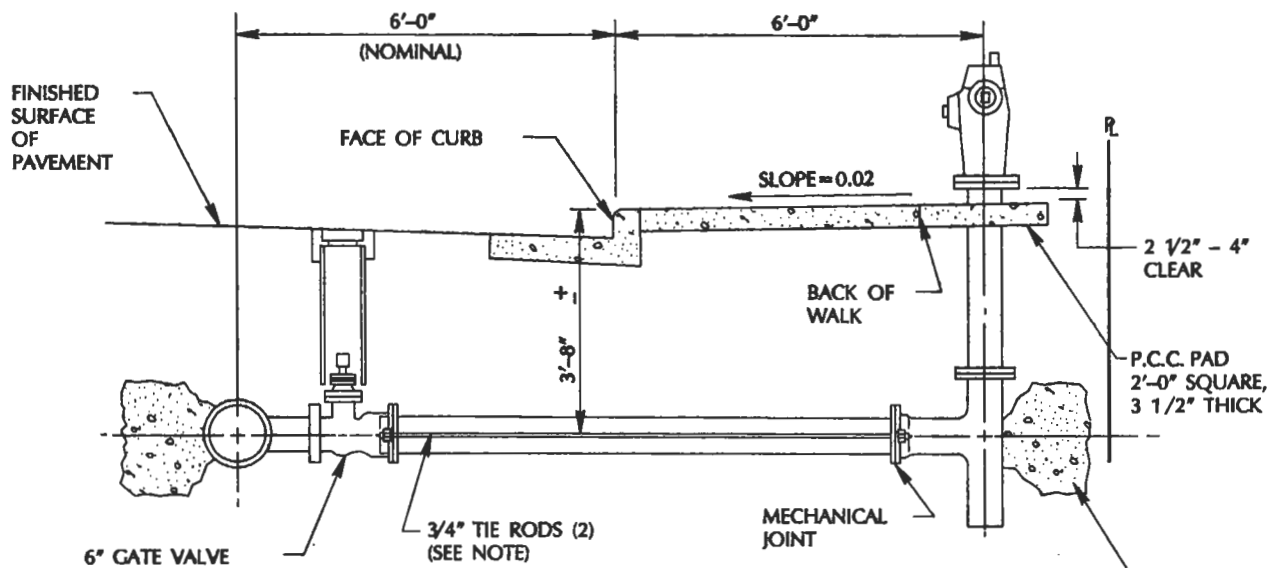

PROFILE

NOTE:

TIE RODS TO BE INSTALLED
IF HYDRANT TEE THRUST
BLOCK IS BEARING ON
DISTURBED SOIL.

THRUST BLOCK
3 SQ. FT. BEARING
MINIMUM

APPROVED BY


JPM

DATE

4/10/92

**ATTACHED RESIDENTIAL SIDEWALK
FIRE HYDRANT INSTALLATION-
END OF RETURN**

DEPARTMENT OF PUBLIC WORKS



DRAWING
NO.

R-14